


GASKETED SEWER FITTING
NO. 52635 (6") AS
MANUFACTURED BY
VASSALLO, INC. OR
APPROVED EQUAL

PVC SERVICE
SDR-26 OR
SCH-40

1/8 BEND-SPIGOT

PVC SERVICE
SDR-26 OR
SCH-40


SADDLE TEE

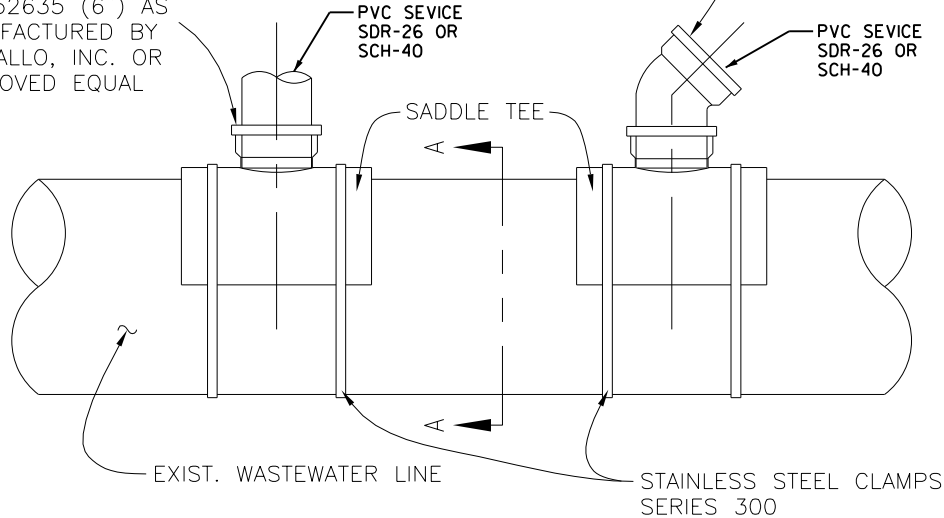

PLAN VIEW

| SADDLE TEE | | | | |
|------------|-------|-------|-------|-------|
| PART NO. | SIZE | L1 | H | P |
| 52635 | 8"x6" | 5.625 | 5.659 | 1.448 |

| PLASTIC TRENDS INC. - 1/8 BEND - SPIGOT | | | | | |
|---|------|--------|-------|-------|-------|
| PART NO. | SIZE | A | B | C | D |
| G 406 | 6 | 11.270 | 6.146 | 1.870 | 6.090 |

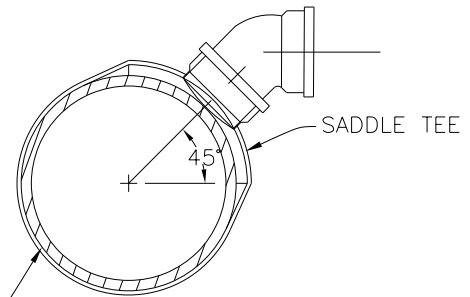

EXIST. WW LINE

SECTION A-A

NOTES:

1. FLEXIBLE SADDLE TO BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S REQUIREMENTS.
2. SADDLE TEE SHALL BE ORIENTATED 45°D TO MAIN. (SEE SEWER SERVICE CONNECTIONS DETAIL).
3. EXCAVATE AROUND EXISTING 8-INCH PIPE, EXPOSING SUFFICIENT ROOM FOR S.S. CLAMPS.
4. THOROUGHLY CLEAN AND DRY THE MATING SURFACE WITH RAG OR PAPER TOWEL MAKE SURE THEY ARE FREE OF DUST AND MOISTURE.
5. MARK THE SIZE OF THE HOLE TO BE CUT USING THE GASKET SKIRT OR THE SADDLE ITSELF AS THE TEMPLATE.
6. SAW OUT THE SECTION OF THE PIPE WHERE THE SADDLE WILL BE LOCATED, WITH A SABER, KEY HOLE SAW, OR CORE DRILL.
7. TEST TO MAKE SURE SADDLE FITS HOLE PROPERLY.
8. SERVICE PIPE SHALL NOT EXTEND MORE THAN ONE-HALF INCH INTO THE MAIN.
9. PLACE GASKET SKIRT AND SADDLE OVER OPENING AND TIGHTEN BAND CLAMPS EVENLY UNTIL SADDLE IS FIRMLY ATTACHED TO THE PIPE. APPLY PRESSURE ON THE SADDLE AGAINST THE PIPE WHILE TIGHTENING THE CLAMPS AS INDICATED ABOVE. DO NOT OVER TIGHTEN, DO NOT STRIP THREAD.
10. REPLACE THE BEDDING AND BACKFILL IN ACCORDANCE WITH THE TRENCH EMBEDMENT DETAIL.
11. THE SERVICE LINE SHALL BE MINIMUM SDR-26 (GREEN), OR SCH-40.


SCALE: NOT TO SCALE



MARBLE FALLS
800 THIRD STREET
MARBLE FALLS, TX 78654
PH: (830) 693-6737

These documents were prepared by,
or under the supervision of:

ERIC BELAJ 107148 May 31, 2017
Engineer's Name PE# Date


Engineer's Signature

SECTION
WASTEWATER

DETAIL NO.
WW-9

TITLE
SERVICE CONNECTION
TO EXISTING LINES