


FINISHED GRADE
(IN PAVEMENT)

FINISHED GRADE
(NOT IN PAVEMENT)

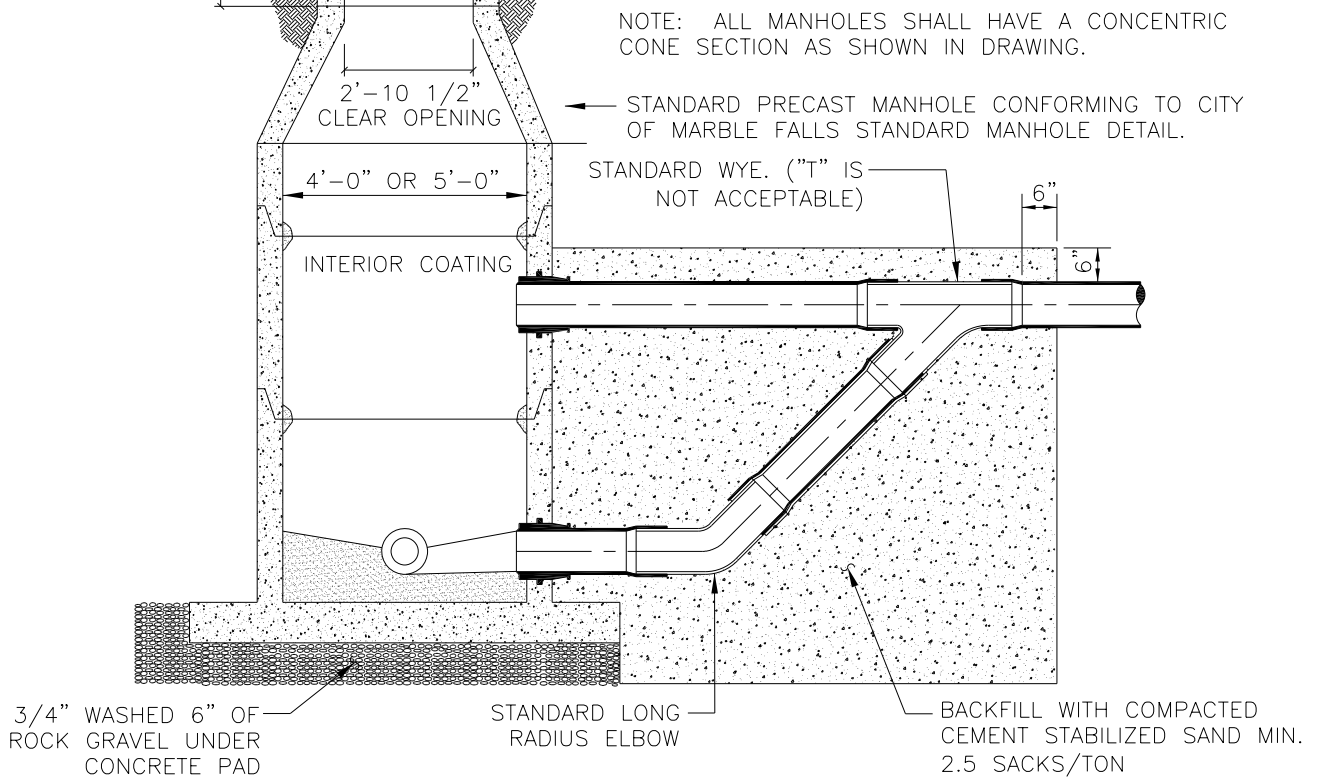

NOTES:

1. DROP CONNECTIONS SHALL BE REQUIRED WHENEVER AN INFLUENT SEWER IS LOCATED TWO (2') OR MORE ABOVE THE MAIN INVERT CHANNEL.
2. A FLOW CHANNEL SHALL BE CONSTRUCTED INSIDE MANHOLE TO DIRECT INFLUENT INTO THE FLOW STREAM.
3. WHEN P.V.C. IS USED IN SANITARY SEWER LINES, SOLVENT TYPE JOINT P.V.C. FITTINGS MAY BE UTILIZED IN THE DROP ASSEMBLY ONLY.
4. MINIMUM PIPE SIZE FOR DROP IS EIGHT INCHES (8").
5. SEE STANDARD DETAIL (STANDARD MANHOLE SECTION) FOR ADDITIONAL REQUIREMENTS.

SCALE: NOT TO SCALE



MARBLE FALLS
 800 THIRD STREET
 MARBLE FALLS, TX 78654
 PH: (830) 693-6737

These documents were prepared by,
or under the supervision of:

ERIC BELAJ 107148 May 31, 2017
 Engineer's Name PE# Date

Engineer's Signature

SECTION
WASTEWATER

DETAIL NO.
WW-15

TITLE
 DROP CONNECTION
 MANHOLE - TYPE 'A'