

FIRE HYDRANT AS SPECIFIED

2 1/2" X 3/4" HYDRANT ADAPTER

3/4" P.V.C. SHC. 40
OR COPPER


3/4" GATE VALVE

1'-6" MINIMUM

2'-0" MINIMUM

FINISHED GRADE

2'-6" MINIMUM
3'-0" TYPICAL

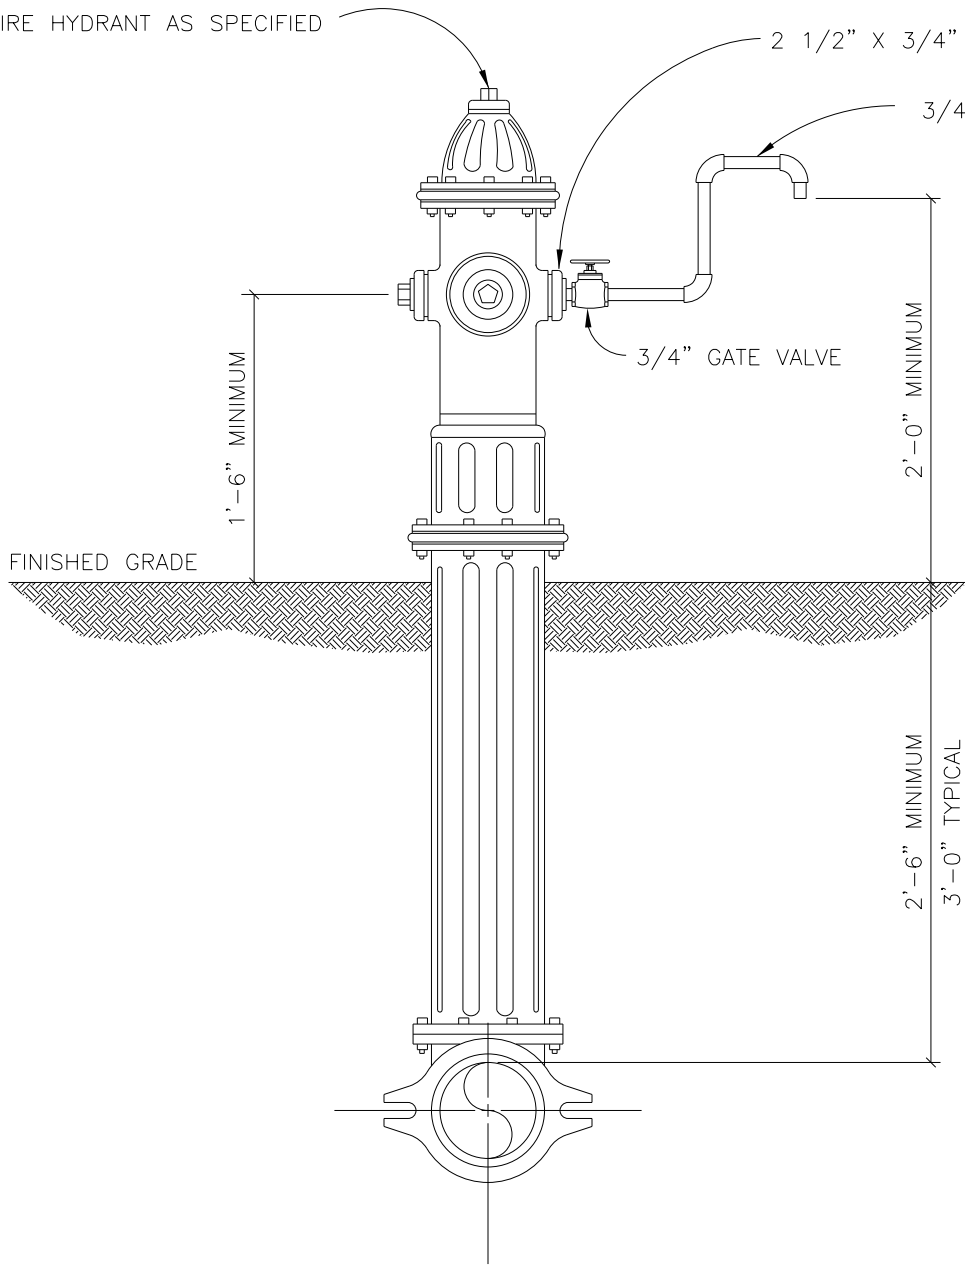


SCALE: NOT TO SCALE



MARBLE FALLS
800 THIRD STREET
MARBLE FALLS, TX 78654
PH: (830) 693-6737

These documents were prepared by,
or under the supervision of:

ERIC BELAJ 107148 May 31, 2017
Engineer's Name PE# Date


Engineer's Signature

SECTION

WATER

DETAIL NO.

WT-31

TITLE

FIRE HYDRANT
SAMPLE POINT