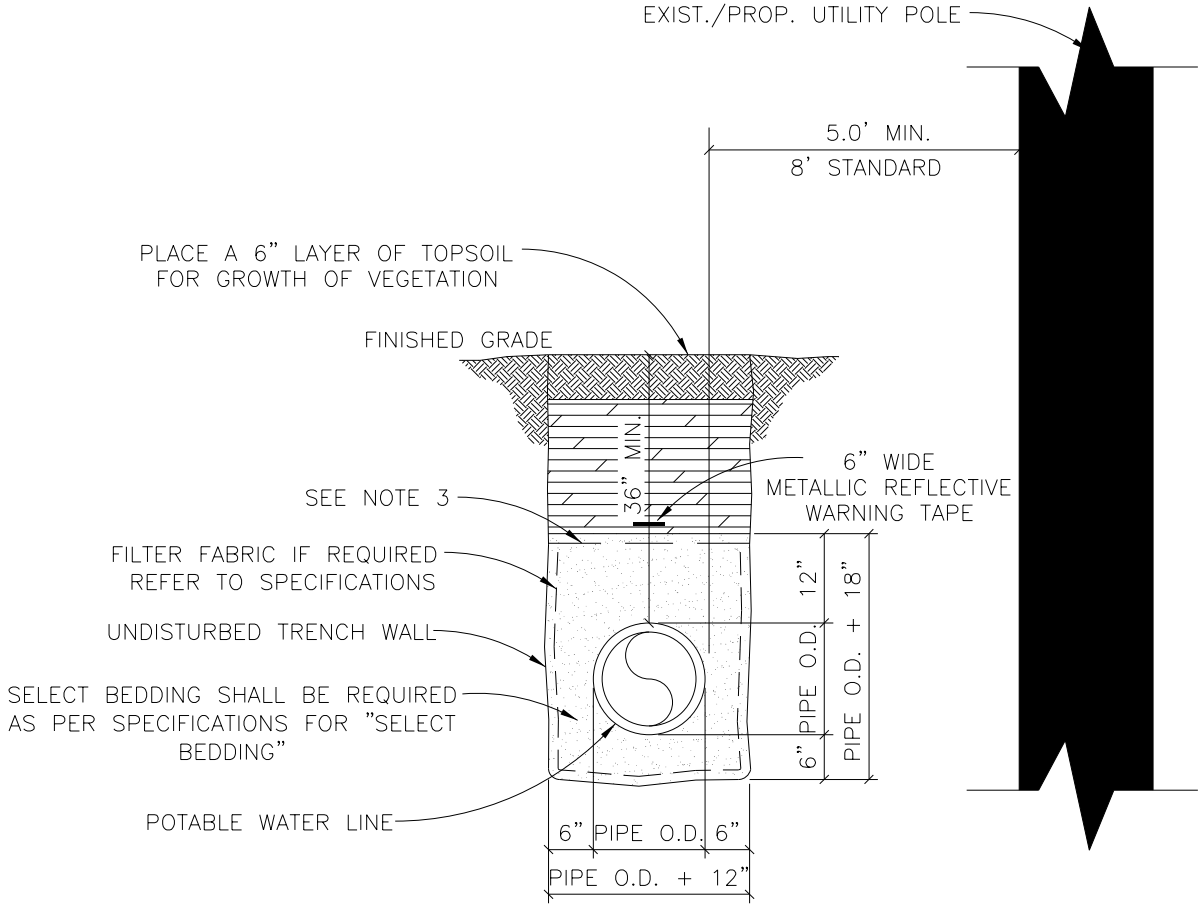

NOTES:

1. ALL CONDUIT TO INCLUDE A 1500 LB CONTINUOUS MULE TAPE IN PLACE BETWEEN PULL BOXES.
2. ALL INSTALLED CONDUITS MUST PASS A PULL TEST WITH A FULL SIZED MANDREL.
3. FILTER FABRIC ALONG THE TOP OF THE TRENCH IS REQUIRED REGARDLESS OF SUBSURFACE CONDITIONS.

SCALE: NOT TO SCALE

Marble Falls
TEXAS

MARBLE FALLS
800 THIRD STREET
MARBLE FALLS, TX 78654
PH: (830) 693-6737

These documents were prepared by, or under the supervision of:

ERIC BELAJ | 107148 | May 31, 2017
Engineer's Name | PE# | Date

Engineer's Signature

SECTION
WATER

DETAIL NO.
WT-1

TITLE
EMBEDMENT UNDER UNPAVED AREAS